

Aluminium soft edge flashing or Flashguard fixed with 12g x 25mm T17 every second rib of roofing

1x12g tek screws through side

0.75 galvanized perforated opening 4.76 Ø at 6.35 centres

200mm min. lap

Throat dimension

Dimond corrugate roofing stop ended

Line of structure

4x 12g x 20mm tek screw

Zincalume or 0.55mm colour finish to match existing

Foam closure strip on top of roofing (see note below)

40mmx5mm galvanised brackets  
4.8 dia Rivets at 300 centres

Dimond corrugate roofing (specify thickness and coating)

Roofing underlay and netting shown dashed

DHS girt


Line of structure

Notes:

- Foam closure strip only required if bird or vermin proofing is required, or if in a high wind area, there is a risk of windblown moisture entering the building.
- These details are suitably fixed to allow for a theoretical thermal movement of up to 10mm. For thermal movement greater than this a clipping system should be considered.

Ridge ventilator table

A	B	C	D	E	F
150	160	60	80	85	55
300	310	100	100	150	100
450	430	160	120	200	150
500	488	240	150	225	175
600	558	250	180	250	200

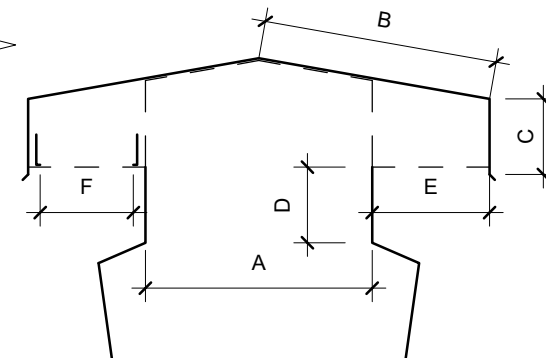

Original Size A4



# Corrugate Roof

Ridged Ventilators Detail

File:	
Issue: 02	Reference
Scale: As indicated	dim_cor_1190
Date: 05 October 2018	